

Appendix C268-B
Correspondence with NCFM

Thomas R. Suozzi
County Executive

Thomas E. Tilley
Fire Marshal



27743.00
Nassau County Fire Commission
Office of Fire Marshal
899 Jerusalem Avenue
P.O. Box 128
Uniondale, New York 11553-0128
(516) 572-1000

Loc. #17210

APPLICATION FOR PUBLIC ACCESS TO RECORDS (REVISED 1/04)

TO: RECORDS ACCESS OFFICER

DATE: July 27, 2009

I HEREBY APPLY TO INSPECT THE FOLLOWING RECORD: (PROVIDE FULL EXACT ADDRESS - 1 ADDRESS PER FORM)
All tank records including, but not limited to, current and historic tank tightness test information at the Nassau County Veterans Memorial Coliseum located at 1255 Hempstead Turnpike (NYS Route 24), Uniondale, New York and at Section 44 Block F Lot 403 on the Nassau County Tax Maps.

REASON FOR INSPECTION: (BE SPECIFIC)

PENDING LITIGATION?

Yes

No

Information is necessary to complete Environmental Assessment for property.

Bryan Murty

NAME (PLEASE PRINT)

VHB Engineering, Surveying &
Landscape Architecture, P.C.

REPRESENTING (BUSINESS NAME / SELF)

X [Signature]

SIGNATURE (ORIGINAL SIGNATURE REQUIRED)

2150 Joshua's Path, Suite 300

ADDRESS

Hauppauge, New York 11788

RELATIONSHIP TO PROPERTY

TELEPHONE (631) 234-3444

- APPROVED
- DENIED FOR REASON(S) CHECKED
- MAINTAINED RECORD CAN NOT BE FOUND
- EXEMPTED BY STATUTE OTHER THAN F.O.I.A.
- UNWARRANTED INVASION OF PERSONAL PRIVACY
- RECORD PART OF INVESTIGATORY FILES

FOR FIRE MARSHAL USE ONLY

SEE ATTACHED UPDATED FORM →

- RECORD IS NOT MAINTAINED BY THIS AGENCY
- COURTESY COMPUTER SEARCH REVEALS NO VIOLATIONS*
(* TITLE SEARCHES ONLY - PHYSICAL FILE MAY DIFFER)
- CONTACT INSPECTOR FOR APPOINTMENT TO VIEW FILE.
FILES MAY BE VIEWED BY APPOINTMENT ONLY. ONLY THE
INSPECTOR LISTED DIRECTLY BELOW MAY ASSIST YOU.

ddutton@nassaucounty.ny.gov

INSPECTOR Dutton

TEL 572-1060

[Signature]

SIGNATURE (APPLICATION PROCESSED BY)

[Signature]

TITLE

8/17/09

DATE

NOTICE: YOU HAVE A RIGHT TO APPEAL DENIAL OF THIS APPLICATION TO THE HEAD OF THIS AGENCY. SUBMIT APPEAL IN WRITING TO, CHIEF FIRE MARSHAL, 899 JERUSALEM AVENUE, P.O. BOX 128, UNIONDALE, NY 11553-0128, WHO MUST FULLY EXPLAIN THE REASON(S) FOR SUCH DENIAL IN WRITING WITHIN SEVEN DAYS OF RECEIPT OF AN APPEAL.

I HEREBY APPEAL

X

DATE

Fenley & Nicol Environmental Inc.
 445 Brook Ave.
 Deer Park, N.Y. 11729
 Phone (631) 586-4900 Fax (631) 586-4920
FAX TRANSMITTAL COVER SHEET
WASTE MANAGEMENT DEPARTMENT
Service/Tank Testing Department

LW # 17210
7/I # 9433128

DATE: 4/20/2009
 COMPANY: Nassau Cty Fire Commission
 ATTN: _____
 FAX NUMBER: 516-572-1056

NUMBER OF PAGES (INCLUDING COVER SHEET): 10

FAXED TO YOU BY:

BRIAN LINEHAN-MGR. OF WASTE MGMT./SERVICE & TANK TESTING-EXT. 139
 X ROSEANN DEGIGLIO-ADMIN. OF WASTE MGMT. & TANK TESTING- EXT. 149

SUBJECT: Results for Nassau Collection

NEED TEST / INSPECTION
#
4/22/2009

9433128
due 4/15/2009

CONFIDENTIALITY NOTE
 THE DOCUMENTS ACCOMPANYING THIS TELECOPY TRANSMISSION CONTAIN INFORMATION WHICH IS CONFIDENTIAL OR PRIVILEGED. THE INFORMATION IS INTENDED FOR THE USE OF THE INDIVIDUAL OR ENTITY NAMED ON THIS TRANSMISSION SHEET. IF YOU ARE NOT THE INTENDED RECIPIENT, BE AWARE THAT DISCLOSURE, COPYING, DISTRIBUTION, OR USE OF THE CONTENTS OF THIS TELECOPIED INFORMATION IS PROHIBITED.

LE A)

(BLF R)



HORNER EZY CHECK II

OWNER OR DEALER NASSAN COLLSTUM

ADDRESS (NO. & STREET) HEARSTONS TRX

CITY AND STATE HE UNIONDALE

TANK INFORMATION

CAPACITY (NOMINAL) 1000

CAPACITY (CHART) 1011

NUMBER OF GALLONS ADDED 4.10 - 8 GALLONS WATER


TOTAL CAPACITY 1013

CONTENTS (PRODUCT) DIESEL CALIBRATION NUMBER 356

MONITOR MODE RESULTS

TIME	RESULT	CI
<u>10:01</u>	<u>+012</u>	<u>+003</u>
<u>10:18</u>	<u>+130</u>	<u>+021</u>
<u>10:40</u>	<u>-343</u>	<u>+056</u>
<u>10:59</u>	<u>-600</u>	<u>+081</u>
_____	_____	_____
_____	_____	_____
_____	_____	_____
_____	_____	_____

TANK LAYOUT

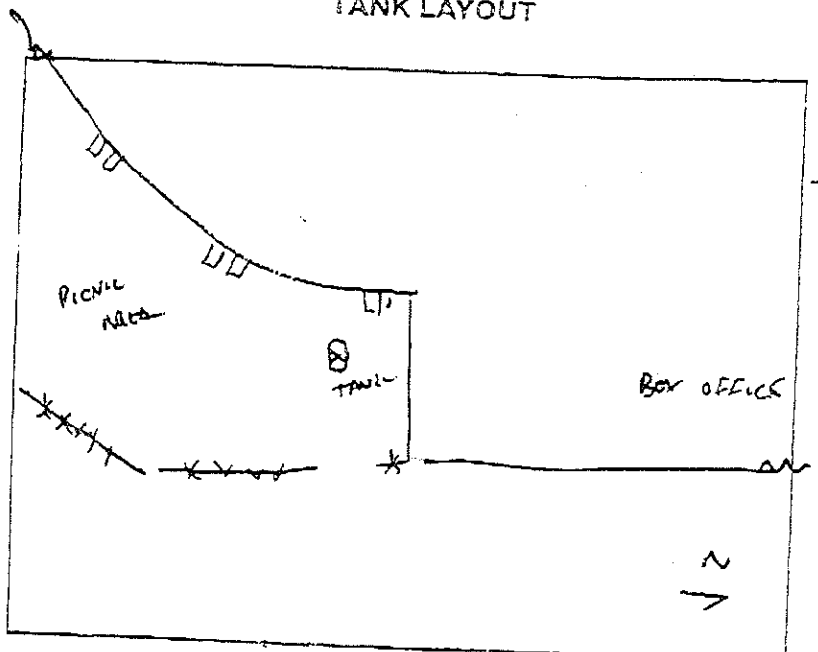

COEFFICIENT CALCULATIONS

MEASURED API GRAVITY 31.3

PRODUCT TEMPERATURE 50

API SPECIFIC GRAVITY @ 60 F. 31.1 + .7 = 31.8 (FROM TABLE A)

COEFFICIENT OF EXPANSION 0.00045063 MM 450 (FROM TABLE B)

HORNER EZY CHECK II TEST LOG



**Fenley & Nicol
Environmental**

445 Brook Avenue, Doer Park, New York 11729
(516) 586-4900

SITE ARRIVAL TIME 630 am pm

CONTACT PERSON JOE Z

TIME OF PRODUCT DELIVERY _____ am pm

AMOUNT OF PRODUCT TO TOP OFF 50

TIME OF EQUIPMENT SET UP 730 am pm

CHANGES TO TANK SYSTEM NONE

ESTIMATED AMOUNT OF PRODUCT TO MAINTAIN TEST LEVEL 10

TIME TEST LEVEL WAS MAINTAINED 830 am pm

TIME OF .4 PSI DROP 840 am pm


TIME OF CALIBRATION 940 am pm

TIME OF TEST COMPLETION 12:07 am pm

DEPTH OF WATER TABLE BELOW BOTTOM OF TANK

REMARKS TANK SYSTEM PASSED @ -007 CPLX

OPERATOR MICHAEL SEPE

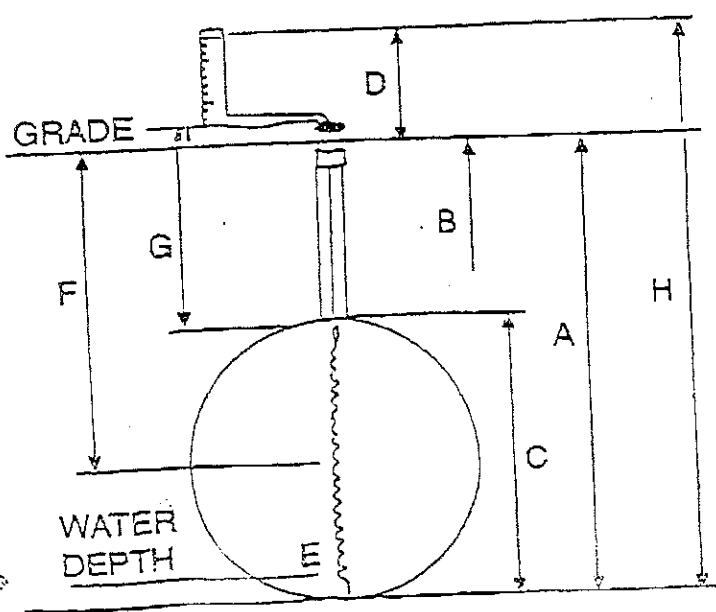

- A. Tank Bot. to Grade 60 "
 - B. Tank Top to Grade 32 "
 - C. Tank Diameter 40 "
 - D. Test Level above grade 50 "
 - E. Depth of water in tank 1 1/2 "
 - F. Depth for taking sample 56 "
 - G. Temp. Probe depth (connector) 32 "
 - H. Test level to Tank Bot. 130 "
 - I. Groundwater above tank bottom / "
 - J. Product Pressure per 1" height 03 PSI
- Test Pressure Formula
 $(130 \times 0.31) - (\text{ } \times .035) = 4.03$

NASSAU COLISEUM
HEMPSTEAD TPK
UNIONDALE N.Y.

4/08/09

DATE: 04/08/09

TIME: 10:42

FUEL TYPE: DIESEL

CAPACITY TANK 1: 1013 GALLONS
TEST CRITERIA: +0.00 GPH TO +0.00 GPH
TEMPERATURE COEFFICIENT: 450 ppm/deg F
RELATIVE FUEL TEMPERATURE 51.70 deg F
VOLUME CHANGE PER DEG F: 0.46 GALLONS

TANK TESTER VER 2.01

TANK 1 CAPACITY CHANGE GALLONS

TANK 2 CAPACITY CHANGE GALLONS

TIME	VOLUME	TEMP.	NET	RATE GPH	VOLUME	TEMP.	NET	RATE GPH
10:42	+0.0000	+0.0000	+0.0000	+0.000				
10:43	+0.0001	-0.0000	+0.0001	+0.012				
10:43	+0.0003	-0.0000	+0.0003	+0.022				
10:44	+0.0003	-0.0000	+0.0003	+0.025				
10:44	+0.0002	-0.0000	+0.0002	+0.026				
10:45	+0.0001	-0.0000	+0.0001	+0.024				
10:45	+0.0001	-0.0000	+0.0001	+0.023				
10:45	+0.0001	-0.0000	+0.0001	+0.021				
10:46	+0.0001	-0.0000	+0.0001	+0.019				
10:47	+0.0001	-0.0000	+0.0001	+0.018				
10:48	+0.0001	-0.0000	+0.0001	+0.017				
10:48	+0.0000	-0.0000	+0.0000	+0.016				
10:49	-0.0001	-0.0000	-0.0001	+0.014				
10:49	-0.0000	-0.0000	-0.0000	+0.013				
10:50	-0.0001	-0.0000	-0.0001	+0.012				
10:50	-0.0001	-0.0000	-0.0001	+0.010				
10:51	-0.0001	-0.0000	-0.0001	+0.009				
10:51	-0.0001	-0.0000	-0.0001	+0.008				
10:52	-0.0001	-0.0000	-0.0001	+0.007				
10:53	-0.0001	-0.0000	-0.0001	+0.006				
10:53	-0.0001	-0.0000	-0.0000	+0.005				
10:54	-0.0001	-0.0000	-0.0001	+0.004				
10:54	-0.0001	-0.0000	-0.0001	+0.003				
10:55	-0.0001	-0.0000	-0.0000	+0.002				
10:55	-0.0001	-0.0000	-0.0000	+0.002				
10:56	-0.0000	-0.0000	-0.0000	+0.001				
10:57	-0.0000	-0.0000	-0.0000	+0.001				
10:57	-0.0000	-0.0000	-0.0000	+0.001				
10:58	-0.0000	-0.0000	-0.0000	+0.000				
10:58	-0.0000	-0.0000	-0.0000	+0.000				
10:59	-0.0000	-0.0000	-0.0000	-0.000				
10:59	+0.0000	+0.0000	+0.0000	+0.000				
11:00	+0.0000	+0.0000	+0.0000	+0.000*				
11:00	-0.0002	-0.0000	-0.0002	-0.021				
11:01	-0.0002	-0.0000	-0.0002	-0.020				
11:02	-0.0002	-0.0000	-0.0002	-0.020				
11:02	-0.0002	-0.0000	-0.0001	-0.019				
11:03	-0.0001	-0.0000	-0.0001	-0.018				
11:03	-0.0001	-0.0000	-0.0001	-0.017				
11:04	-0.0001	-0.0000	-0.0001	-0.016				
11:04	-0.0001	-0.0000	-0.0001	-0.015				

START
LAST
MONITOR
MON
END
LAST
MONITOR
MON

NASSAU COLISEUM

HEMPSTEAD TPK

UNIONDALE N.Y.

DATE: 04/08/08

TIME: 09:43

FUEL TYPE: DIESEL

CAPACITY TANK 1: 1013 GALLONS

TEST CRITERIA: +0.00 GPH TO +0.00 GPH

TEMPERATURE COEFFICIENT: 450 ppm/deg F

RELATIVE FUEL TEMPERATURE 58.23 deg F

VOLUME CHANGE PER DEG F: 0.46 GALLONS

TANK TESTER VER 2.01

TANK 1 CAPACITY CHANGE GALLONS

TANK 2 CAPACITY CHANGE GALLONS

TIME	VOLUME	TEMP.	NET	RATE GPH	VOLUME	TEMP.	NET	RATE GPH
09:44	+0.0000	+0.0000	+0.0000	+0.000				
09:44	-0.0001	+0.0001	-0.0002	-0.019				
09:45	-0.0002	+0.0001	-0.0003	-0.025				
09:45	+0.0000	+0.0001	-0.0001	-0.020				
09:46	+0.0000	+0.0001	-0.0001	-0.018				
09:47	-0.0000	+0.0000	-0.0000	-0.015				
09:47	-0.0000	-0.0000	-0.0000	-0.013				
09:48	+0.0000	-0.0001	+0.0002	-0.010				
09:48	+0.0000	-0.0002	+0.0002	-0.005				
09:49	+0.0000	-0.0001	+0.0002	-0.003				
09:49	+0.0000	-0.0001	+0.0001	-0.000				
09:50	+0.0000	-0.0001	+0.0002	+0.002				
09:50	+0.0000	-0.0000	+0.0000	+0.003				
09:51	+0.0000	+0.0002	-0.0001	+0.003				
09:52	+0.0000	-0.0002	+0.0002	+0.004				
09:52	+0.0000	+0.0000	+0.0000	+0.004				
09:53	+0.0000	-0.0002	+0.0002	+0.005				
09:53	+0.0000	+0.0001	-0.0001	+0.005				
09:54	-0.0000	+0.0003	-0.0003	+0.004				
09:54	+0.0000	+0.0000	-0.0000	+0.004				
09:55	-0.0000	+0.0001	-0.0002	+0.003				
09:55	-0.0000	+0.0000	-0.0000	+0.002				
09:56	+0.0000	+0.0002	-0.0002	+0.002				
09:57	-0.0000	+0.0005	-0.0005	+0.001				
09:57	+0.0000	+0.0001	-0.0001	-0.000				
09:58	+0.0001	-0.0007	+0.0008	-0.000				
09:58	+0.0001	-0.0011	+0.0012	+0.001				
09:59	+0.0002	-0.0010	+0.0012	+0.003				
09:59	+0.0000	-0.0008	+0.0008	+0.005				
10:00	-0.0001	-0.0007	+0.0006	+0.007				
10:01	-0.0000	-0.0007	+0.0006	+0.012				
10:01	+0.0000	+0.0000	+0.0000	+0.000				
10:02	-0.0000	+0.0005	-0.0005	-0.049				
10:02	-0.0000	+0.0003	-0.0003	-0.042				
10:03	-0.0000	-0.0003	+0.0002	-0.022				
10:03	-0.0001	-0.0003	+0.0003	-0.008				
10:04	-0.0001	-0.0001	+0.0001	-0.002				
10:04	-0.0001	-0.0007	+0.0005	+0.007				
10:05	-0.0001	-0.0003	+0.0003	+0.013				
10:05	-0.0001	-0.0006	+0.0005	+0.019				
10:06	-0.0000	-0.0007	+0.0007	+0.024				

	-0.0001	-0.0007	+0.0006	+0.030
10:07	-0.0000	-0.0007	+0.0007	+0.034
10:08	-0.0001	-0.0012	+0.0011	+0.040
10:08	-0.0000	-0.0008	+0.0008	+0.045
10:09	-0.0000	-0.0004	+0.0004	+0.048
10:09	-0.0000	-0.0005	+0.0004	+0.050
10:10	-0.0001	+0.0000	-0.0001	+0.050
10:11	-0.0001	-0.0007	+0.0006	+0.050
10:11	-0.0001	-0.0006	+0.0005	+0.051
10:12	-0.0001	-0.0004	+0.0004	+0.051
10:12	-0.0001	+0.0003	-0.0004	+0.050
10:13	-0.0001	-0.0101	+0.0100	+0.061
10:13	-0.0001	-0.0022	+0.0020	+0.071
10:14	-0.0001	-0.0023	+0.0022	+0.080
10:15	-0.0001	-0.0023	+0.0021	+0.089
10:15	-0.0001	-0.0018	+0.0017	+0.097
10:15	-0.0001	-0.0016	+0.0015	+0.103
10:16	-0.0001	-0.0019	+0.0018	+0.109
10:17	-0.0001	-0.0025	+0.0024	+0.115
10:17	-0.0001	-0.0041	+0.0040	+0.122
10:18	-0.0001	-0.0045	+0.0043	+0.130
10:18	+0.0000	+0.0000	+0.0000	+0.000

MASSAU COLISEUM

HEMPSTEAD TPK

UNIONDALE N.Y.

DATE: 04/08/08

TIME: 10:23

FUEL TYPE: DIESEL

CAPACITY TANK 1: 1013 GALLONS

TEST CRITERIA: +0.00 GPH TO +0.00 GPH

TEMPERATURE COEFFICIENT: 450 ppm/deg F

RELATIVE FUEL TEMPERATURE 58.29 deg F

VOLUME CHANGE PER DEG F: 0.46 GALLONS

TANK TESTER VER 2.01

TANK 1 CAPACITY CHANGE GALLONS

TANK 2 CAPACITY CHANGE GALLONS

TIME	VOLUME	TEMP.	NET	RATE GPH	VOLUME	TEMP.	NET	RATE GPH
10:23	+0.0000	+0.0000	+0.0000	+0.000				
10:23	+0.0001	-0.0001	+0.0002	+0.022				
10:24	+0.0000	-0.0001	+0.0002	+0.020				
10:25	+0.0000	-0.0221	+0.0222	+0.728				
10:25	+0.0000	-0.0001	+0.0002	+0.727				
10:25	+0.0000	+0.0003	-0.0002	+0.617				
10:25	+0.0000	+0.0004	-0.0004	+0.509				
10:27	+0.0001	+0.0003	-0.0002	+0.419				
10:27	-0.0000	+0.0002	-0.0002	+0.348				
10:28	-0.0000	-0.0000	-0.0000	+0.293				
10:29	+0.0000	-0.0004	+0.0004	+0.252				
10:29	+0.0001	-0.0015	+0.0016	+0.225				
10:30	+0.0000	-0.0005	+0.0005	+0.202				
10:30	-0.0000	-0.0005	+0.0005	+0.184				
10:31	+0.0001	-0.0004	+0.0004	+0.169				
10:31	+0.0002	-0.0009	+0.0011	+0.158				
10:32	+0.0000	-0.0017	+0.0017	+0.151				
10:32	-0.0002	-0.0015	+0.0013	+0.145				
10:33	-0.0006	-0.0017	+0.0010	+0.141				
10:34	-0.0003	-0.1608	+0.1604	+0.382				
DATA OUT OF RANGE								
TANK 1 TEST TO BE RE-STARTED								
10:34	+0.0000	+0.0000	+0.0000	+0.000				
10:35	+0.0000	+0.0042	-0.0041	-0.450				
10:35	-0.0000	+0.0039	-0.0039	-0.433				
10:36	-0.0000	+0.0037	-0.0037	-0.421				
10:36	+0.0000	+0.0035	-0.0035	-0.411				
10:37	+0.0000	+0.0034	-0.0033	-0.399				
10:37	+0.0000	+0.0032	-0.0031	-0.389				
10:38	+0.0001	+0.0030	-0.0029	-0.378				
10:39	-0.0001	+0.0028	-0.0029	-0.369				
10:39	-0.0000	+0.0027	-0.0027	-0.360				
10:40	+0.0001	+0.0025	-0.0025	-0.351				
10:40	-0.0001	+0.0024	-0.0025	-0.343				

11:05	-0.0001	-0.0000	-0.0001	-0.015
11:05	-0.0001	-0.0000	-0.0001	-0.014
11:06	-0.0001	-0.0000	-0.0001	-0.014
11:07	-0.0001	-0.0000	-0.0001	-0.013
11:07	-0.0001	-0.0000	-0.0001	-0.013
11:08	-0.0001	-0.0000	-0.0001	-0.012
11:08	-0.0001	-0.0000	-0.0001	-0.012
11:09	-0.0001	-0.0000	-0.0001	-0.011
11:09	-0.0001	-0.0000	-0.0001	-0.011
11:10	-0.0001	-0.0000	-0.0001	-0.011
11:11	-0.0000	-0.0000	-0.0000	-0.010
11:11	+0.0000	-0.0000	+0.0001	-0.010
11:12	-0.0000	-0.0000	-0.0002	-0.010
11:12	-0.0001	-0.0000	-0.0001	-0.010
11:13	-0.0002	-0.0000	-0.0002	-0.010
11:13	-0.0002	-0.0000	-0.0002	-0.010
11:14	+0.0002	-0.0000	-0.0002	-0.010
11:14	-0.0001	-0.0000	-0.0001	-0.010
11:15	-0.0001	-0.0000	-0.0001	-0.010
11:16	-0.0001	-0.0000	-0.0000	-0.010
11:16	-0.0002	-0.0000	-0.0002	-0.010
11:17	-0.0001	-0.0000	-0.0001	-0.010
11:17	-0.0001	-0.0000	-0.0001	-0.010
11:18	-0.0002	-0.0000	-0.0002	-0.011
11:18	-0.0002	-0.0000	-0.0002	-0.011
11:19	-0.0001	-0.0000	-0.0001	-0.011
11:19	-0.0001	-0.0000	-0.0001	-0.011
11:20	-0.0001	-0.0000	-0.0001	-0.011
11:21	-0.0001	-0.0000	-0.0001	-0.011
11:21	-0.0001	-0.0000	-0.0001	-0.011
11:22	-0.0001	-0.0000	-0.0001	-0.011
11:22	-0.0001	+0.0000	-0.0001	-0.011
11:23	-0.0001	-0.0000	-0.0001	-0.011
11:23	-0.0000	+0.0000	-0.0000	-0.011
11:24	-0.0000	+0.0000	-0.0000	-0.011
11:25	-0.0001	+0.0000	-0.0001	-0.011
11:25	-0.0000	+0.0000	-0.0000	-0.011
11:26	-0.0000	+0.0000	-0.0000	-0.011
11:26	-0.0000	+0.0000	-0.0000	-0.011
11:27	+0.0000	+0.0000	+0.0000	-0.011
11:27	-0.0000	+0.0000	-0.0000	-0.011
11:28	-0.0000	-0.0000	-0.0000	-0.011
11:28	-0.0001	-0.0000	-0.0000	-0.011
11:29	-0.0000	+0.0000	-0.0000	-0.011
11:30	-0.0000	-0.0000	-0.0000	-0.010
11:30	-0.0000	+0.0000	-0.0000	-0.010
11:31	-0.0000	-0.0000	-0.0000	-0.010
11:31	-0.0001	-0.0000	-0.0001	-0.010
11:32	-0.0000	-0.0000	-0.0000	-0.010
11:32	+0.0000	-0.0000	+0.0000	-0.010
11:33	-0.0000	+0.0000	-0.0000	-0.010

VOLUME RATE OF CHANGE -0.010 GPH
99 % CONFIDENCE INTERVAL: +/-0.001 GPH
RELATIVE FUEL TEMPERATURE: 51.69 deg F

11:33	+0.0000	-0.0000	+0.0000	-0.010
11:34	+0.0000	-0.0000	+0.0000	-0.009
11:35	-0.0000	-0.0000	+0.0000	-0.009
11:35	-0.0000	-0.0000	-0.0000	-0.009
11:35	-0.0001	+0.0000	-0.0001	-0.009

11:36	-0.0001	-0.0000	-0.0001	-0.0009
11:37	-0.0001	-0.0000	-0.0001	-0.0009
11:37	-0.0001	-0.0000	-0.0001	-0.0009
11:38	-0.0001	-0.0000	-0.0001	-0.0009
11:39	-0.0001	-0.0000	-0.0001	-0.0009
11:39	-0.0001	-0.0000	-0.0001	-0.0009
11:40	-0.0001	+0.0000	-0.0001	-0.0008
11:40	-0.0001	+0.0000	-0.0001	-0.0008
11:41	-0.0001	+0.0000	-0.0001	-0.0008
11:41	-0.0001	+0.0000	-0.0001	-0.0008
11:42	-0.0001	+0.0000	-0.0001	-0.0008
11:42	-0.0001	+0.0000	-0.0001	-0.0008
11:43	-0.0001	+0.0000	-0.0001	-0.0008
11:44	-0.0001	+0.0000	-0.0001	-0.0008
11:44	-0.0001	+0.0000	-0.0001	-0.0008
11:45	-0.0001	+0.0000	-0.0001	-0.0008
11:45	-0.0001	+0.0000	-0.0001	-0.0008
11:46	-0.0000	+0.0000	-0.0000	-0.0008
11:46	-0.0001	+0.0000	-0.0001	-0.0008
11:47	-0.0001	+0.0000	-0.0001	-0.0008
11:47	-0.0001	+0.0000	-0.0001	-0.0008
11:48	-0.0001	+0.0000	-0.0001	-0.0008
11:49	-0.0001	+0.0000	-0.0001	-0.0008
11:49	-0.0001	+0.0000	-0.0001	-0.0008
11:50	-0.0001	+0.0000	-0.0001	-0.0008

VOLUME RATE OF CHANGE -0.008 GPH
 99 % CONFIDENCE INTERVAL: +/-0.000 GPH
 RELATIVE FUEL TEMPERATURE: 51.69 deg F

11:50	-0.0001	+0.0000	-0.0001	-0.0008
11:51	-0.0001	+0.0000	-0.0001	-0.0008
11:51	-0.0001	+0.0000	-0.0001	-0.0008
11:52	-0.0000	+0.0000	-0.0000	-0.0008
11:53	-0.0000	+0.0000	-0.0000	-0.0008
11:53	+0.0000	+0.0000	-0.0000	-0.0008
11:54	-0.0000	+0.0000	-0.0000	-0.0008
11:54	+0.0000	+0.0000	-0.0000	-0.0008
11:55	-0.0000	+0.0000	-0.0000	-0.0008
11:55	-0.0000	+0.0000	-0.0000	-0.0008
11:56	+0.0000	+0.0000	+0.0000	-0.0008
11:56	+0.0000	+0.0000	+0.0000	-0.0008
11:57	+0.0000	+0.0000	+0.0000	-0.0008
11:58	+0.0000	+0.0000	+0.0000	-0.0008
11:58	+0.0000	+0.0000	+0.0000	-0.0008
11:59	+0.0000	+0.0000	+0.0000	-0.0008
11:59	+0.0000	+0.0000	+0.0000	-0.0008
12:00	+0.0000	+0.0000	+0.0000	-0.0008
12:00	+0.0000	+0.0000	+0.0000	-0.0008
12:01	+0.0001	+0.0000	+0.0001	-0.0008
12:01	+0.0000	+0.0000	+0.0000	-0.0008
12:02	+0.0000	+0.0000	+0.0000	-0.0008
12:03	+0.0001	+0.0000	+0.0001	-0.0007
12:03	+0.0001	+0.0000	+0.0001	-0.0007
12:04	+0.0001	+0.0000	+0.0001	-0.0007
12:04	+0.0000	+0.0000	+0.0000	-0.0007
12:05	+0.0000	+0.0000	+0.0000	-0.0007
12:05	+0.0000	+0.0000	+0.0000	-0.0007
12:05	+0.0001	+0.0000	+0.0000	-0.0007

12:07 +0.0000 +0.0000 +0.0000 -0.007
 VOLUME RATE OF CHANGE -0.007 GPH

END
 TCU
 Mon

SAU COLISEUM
 HEMPSTEAD TPK
 UNIONDALE N.Y.
 TANK TESTER VER 2.01
 FUEL TYPE: DIESEL
 CAPACITY TANK 1: 1013 GALLONS
 TEMPERATURE COEFFICIENT: 450 ppm/deg F
 TEST CRITERIA: +0.000 GPH TO +0.000 GPH

04/09/08 TEST TIME FROM 11:00 TO 12:07
 DATA ANALYSIS INDICATES:

A GROSS VOLUME CHANGE OF: -0.007 GALLONS
 A VOLUME CHANGE DUE TO TEMPERATURE OF: -0.000 GALLONS
 A LIQUID VOLUME RATE OF CHANGE OF: -0.007 GPH
 WITH A 99 % CONFIDENCE INTERVAL OF: +/-0.000 GPH
 (-0.007 TO -0.007 GPH)

TESTER..... *M. Serr*
 MICHAEL SERR

CUSTOMER.....